


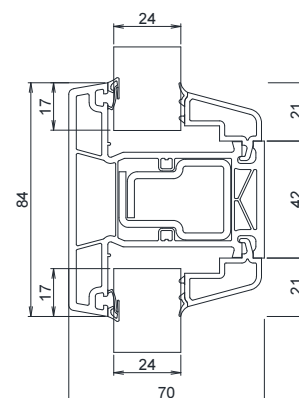
Number	17-003071-PR04 (NW-K20-06-en-01)
Owner	profine GmbH International Profile Group Zweibrücker Straße 200 66954 Pirmasens Germany
Product	Plastic Profile, profile combination: Mullion
Designation	System: KBE 70 KÖMMERLING 70 TROCAL 70
Details	Material Polyvinyl Chloride unplasticized (PVC-U); Projected width 84 mm; Structural depth 70 mm; Mullion: Designation 70320; Cross section (W x T) 84 mm x 70 mm; Thickness of infill 24 mm; Edge cover of infill 17 mm; Reinforcement material Metal - Steel - galvanised
Special features	

Result	Thermal transmittance according to EN 12412-2:2003-07  $U_f = 1,5 \text{ W/(m}^2\text{K)}$
--------	---

Basis *)

Test report: 17-003071-PR04 PB-K20-06-de-01

Representation



Instructions for use

The results obtained can be used as evidence in accordance with the above basis.

Validity

There is no time limit. When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

The data and results given relate solely to the tested/described specimen. This test/evaluation does not allow any statement to be made on further characteristics of the present structure regarding performance and quality.

Notes on publication

The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

ift Rosenheim
05.03.2018



Konrad Huber, Dipl.-Ing. (FH)
Head of Testing Department
Building Physics



Stefan Junker, Dipl.-Ing. (FH)
Operating Testing Officer
Building Physics

Identity-Check



www.ift-rosenheim.de/ift-geprueft
ID: 178-ADC5A